


## CLUB KENO TERMINAL ELECTRICAL POWER AND COMMUNICATION SPECIFICATIONS

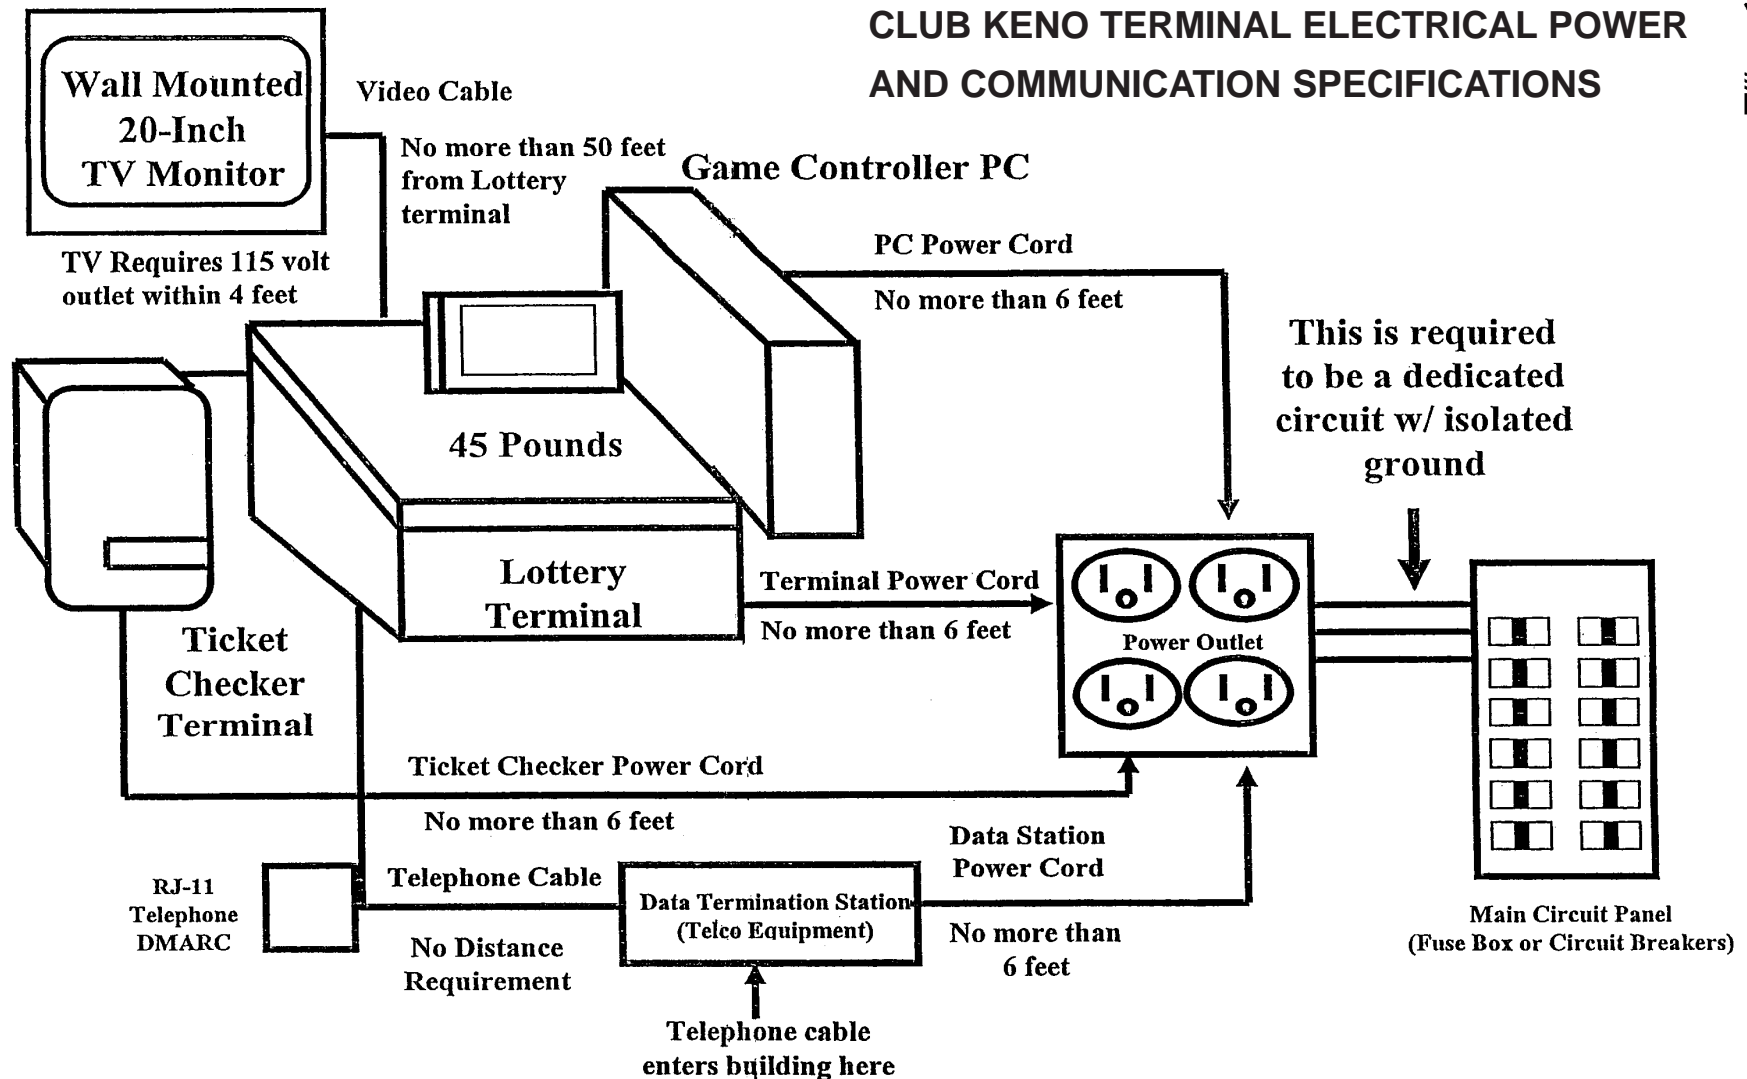

A retailer is required to provide sufficient space for the terminal with minimum requirements being 25.5 in. wide by 25 in. deep by 34 in. high. Provision must be made for free access to the keys from the front of the terminal, and unobstructed room to raise the terminal lid for the loading of ticket stock and ribbons.

The retailer is required to provide a dedicated 3-wire 20 amp, 115 volt, 60Hz AC circuit. The power outlet is required to be a quad receptacle properly wired to meet local and state electrical codes. The fourth receptacle is for future Lottery use and is not to be used for any reason.